


PITCHED ROOF UNDERLAYS BS 5534:2014

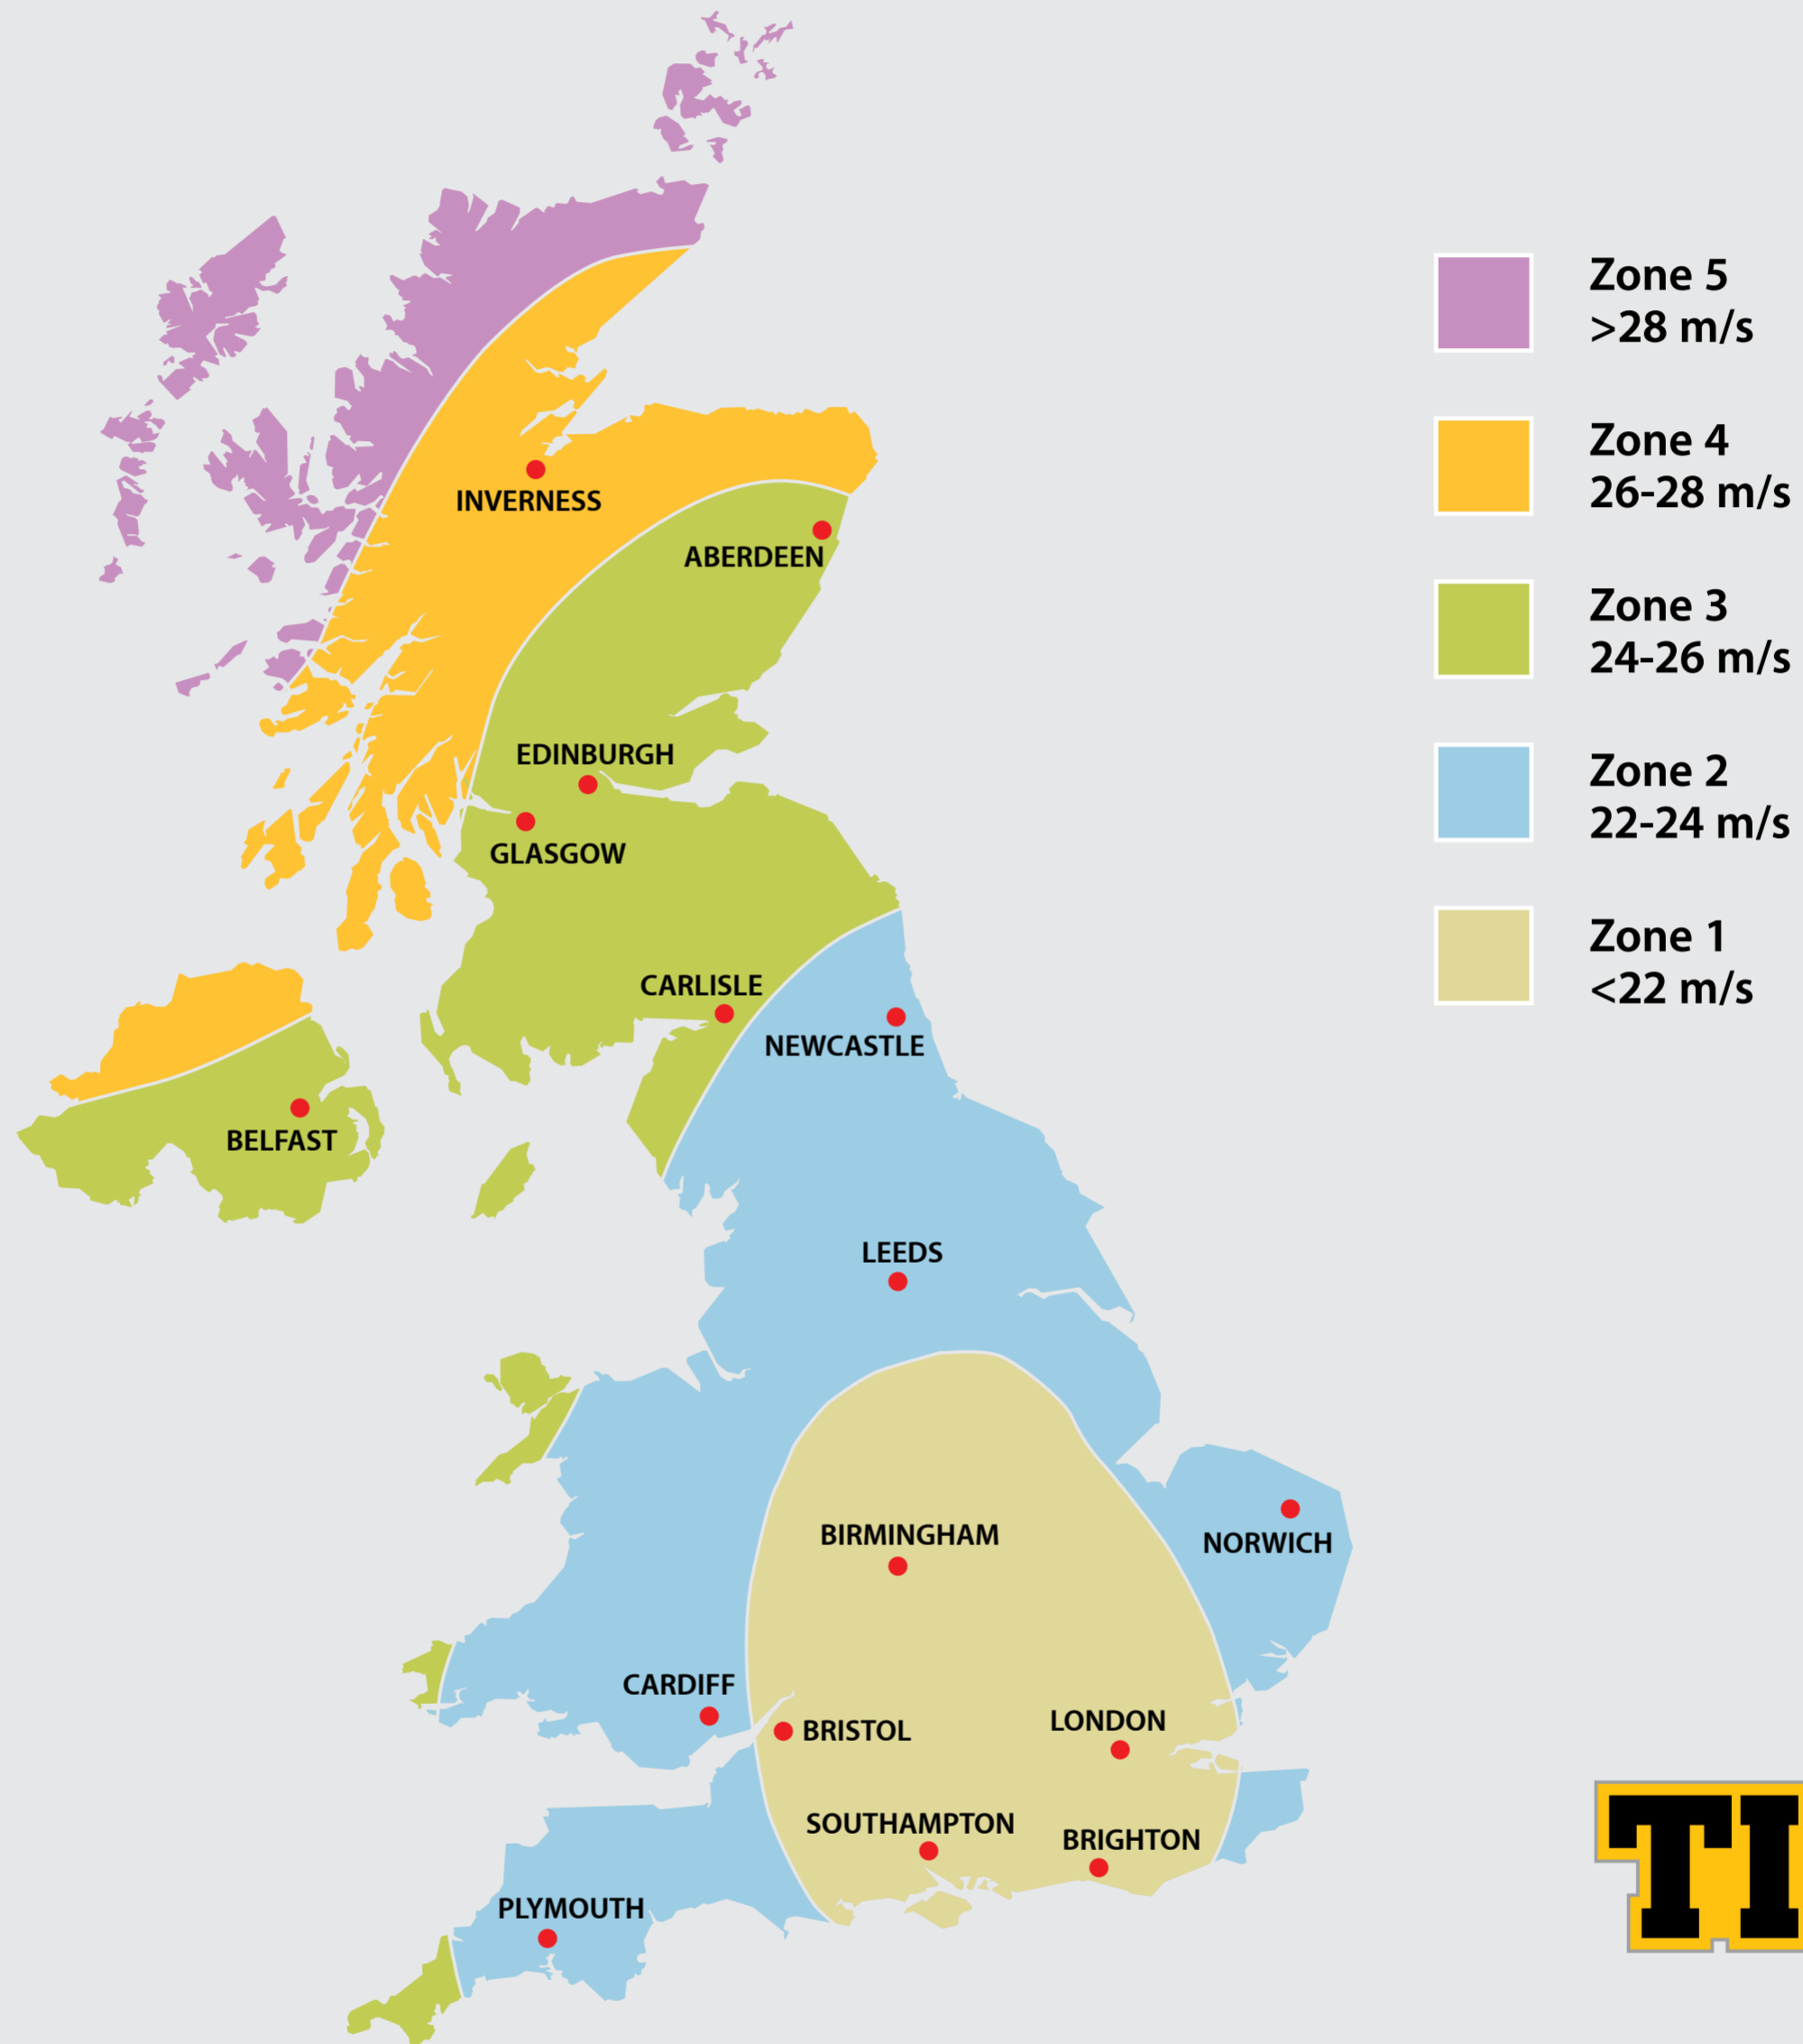

SUMMARY OF TEST RESULTS FOR WIND UPLIFT RESISTANCE OF UNDERLAYS TO BS 5534:2014 ANNEX A*

Underlay name		Geographical Wind Zones			
		STANDARD		WITH INTEGRATED TAPE (PLUS VERSION)	
		Batten Gauge 345mm	Batten Gauge 250mm	Batten Gauge 345mm	Batten Gauge 250mm
TIL-R Breathable 120g		Zones 1 to 3	Zones 1 to 5	Zones 1 to 5	Zones 1 to 5
TIL-R Classic Breathable 100g		Zones 1 to 2	Zones 1 to 5	Zones 1 to 5	Zones 1 to 5
TIL-R Classic Non Breathable 120g		Zones 1 to 5	Zones 1 to 5	Zones 1 to 5	Zones 1 to 5

*See section A7 of test criteria.

PLEASE ASK FOR FURTHER INFORMATION.

www.sigroofing.co.uk